



Stevensville-Douglastown Lagoon Annual Performance Report – Treatment and Collection Reporting Year: 2025

Table of Contents:

Stevensville-Douglastown Wastewater Treatment Plant Annual Performance Report (SD-T)	
Table of Contents:	2
List of Tables:.....	3
List of Figures:	3
SD-T-1 Wastewater Treatment Process Description	5
SD-T-2 Review of Lagoon Flows and Lagoon Influent Sampling and Monitoring	6
Review of 2025 Lagoon Flows	6
Review of Influent Sampling and Monitoring Activities	7
Review of Final Effluent Sampling and Monitoring Activities	8
Effluent Quality Assurance Measurements and Control Measures	10
Deviations from Scheduled Monitoring Program	11
SD-T-3 Description of Operating Problems Encountered and Corrective Actions Taken	14
SD-T-4 Summary of Major Maintenance Activities and Capital Works	14
Summary of Maintenance Carried out on Major Equipment.....	14
Planned Capital Upgrades	15
Summary and Update of Notice of Modifications Completed	15
Proposed Works – Status Update	15
SD-T-5 Summary Calibration Activities.....	15
Flow Meter Calibration – Influent, and Effluent	15
Effluent Monitoring Equipment Calibration/Verification	16
SD-T-6 Solids Handling	16
Processed Organics Received.....	16
Volumes of Sludge Generated and Removed From Site	16
Sludge Quality Monitoring	16
SD-T-7 Complaints	16
SD-T-8 Bypasses, Overflows, Other Situations Outside Normal Operating, Spills and Abnormal Discharge Events	17
Bypasses and Overflows.....	17
Situations Outside of Normal Operating Conditions.....	17
Spills	17
Abnormal Discharges.....	18
SD-T-9 Summary of Efforts to Achieve Conformance with F-5-1 and/or F-5-5.....	18
Summary of Efforts – Procedure F-5-1 – Secondary Treatment Equivalent	18
Summary of Efforts – Procedure F-5-1 – Sewage Bypass/Overflow from Nominally Separated System	18
Industrial Waste	18

Niagara Region – Stevensville-Douglastown Wastewater System
2025 Annual Performance and Summary Report - Treatment

In 2024, an update to the Sewer Use By-law was approved by Council. Sewer Use By-law 2024-51 is still in place ensuring better protection of Niagara Region wastewater infrastructure. 19
Summary of Efforts – Procedure F-5-5 19

List of Tables:

Table SD-T-1: Table of Stevensville-Douglastown Lagoon 2025 Treated Sewage Flows 6
Table SD-T-2: Evaluation of Final Effluent sample results to ECA objectives and compliance limits 9
Table SD-T-3: Annual Summary of Lagoon Flows, Influent and Effluent Sampling and Monitoring Results 12
Table SD-T-4: Summary of Flow Meter Calibration 15
Table SD-T-5: Summary of Calibration/Verification of Effluent Monitoring Equipment 16
Table SD-T-6: Summary of spills occurring at the Stevensville-Douglastown Lagoons during the reporting year 17

List of Figures:

Figure SD-T-1: Graph displaying the Monthly Average Daily Flow Rate in MLD 7
Figure SD-T-2: Figure of monthly lagoon loadings to the Stevensville-Douglastown Lagoon for Biochemical Oxygen Demand (TBOD), Total Suspended Solids (TSS), Total Kjeldahl Nitrogen (TKN) and Total Phosphorus (TP), in kg/d, for the period 2023 to 2025..... 8

Stevensville-Douglastown Wastewater Collection System Annual Performance Report (SD-C)

List of Tables..... 4
 List of Figures 4
 SD-C-1 Overview of the Stevensville-Douglastown Lagoon Collection System 20
 SD-C-2 Summary and Interpretation of Collection System Monitoring Data..... 21
 Monitoring of Pump Station Operations 21
 Sanitary Sewer Closed-Circuit Television Inspection Program 21
 Flow Monitoring..... 22
 SD-C-3 Summary of Operating Issues Encountered and Corrective Actions Taken 22
 Pump Stations and Forcemains 22
 Gravity Trunk Sewers..... 22
 SD-C-4 Summary of Major Maintenance, Capital Projects and Pre-Authorized Alterations 22
 Summary of Maintenance Carried out on Major Equipment..... 22
 Planned Capital Upgrades 23
 Summary of Pre-Authorized Alterations Undertaken 23
 SD-C-5 Summary of Calibration Activities 23
 SD-C-6 Summary of Complaints 23
 SD-C-7 Summary of Collection System Overflows and Spills 24
 Collection System Overflows 24
 Collection System Spills..... 24
 SD-C-8 Summary of Efforts to Reduce Lagoon Bypasses/Overflows and Collection System
 Overflows..... 24
 Projects Undertaken to Reduce Bypasses or Overflows..... 24
 Public Reporting of Bypasses and Overflows 25

List of Tables

Table SD-C- 1- CCTV Program Summary..... 22

List of Figures

Figure SD-C- 1: Map of Stevensville-Douglastown Lagoon Collection System 20
 Figure SD-C- 2 - Image of Sanitary Sewer Overflow Public Signage 26

SD-T-1 Wastewater Treatment Process Description

The Stevensville-Douglastown Lagoon is located at 3274 Netherby Road in the City of Niagara Falls but provides wastewater treatment to the portions of the Town of Fort Erie known as Stevensville, Black Creek and Douglastown. The Stevensville-Douglastown Lagoon is a Class I facultative lagoon treatment facility and has a rated capacity of 2,289 m³/d. Final effluent discharges to the Niagara River.

The Stevensville-Douglastown Lagoon operates under the following MECP approvals:

Environmental Compliance Approval (Sewage): 2588-7JTL5C, Issued October 2, 2008

Environmental Compliance Approval (Air): 6183-7ZNSYH, Issued January 15, 2010

The Stevensville-Douglastown Lagoon uses the following processes to treat wastewater:

- Facultative Lagoon Process
- Aeration
- Phosphorus Removal
- Treated Effluent Pumping

Facultative Lagoons:

These lagoons slow down the movement of the wastewater causing suspended solids to settle into a thick sludge layer at the bottom. Anaerobic bacteria in this layer consume and breakdown the solids. Algae in the upper layer of water in the lagoon consume the dissolved materials in the wastewater.

Aeration: Lagoon one (1) is divided in half with a floating baffle curtain. The first half is equipped with fine bubble diffusers which provide aeration to the incoming raw influent wastewater. Aeration of the wastewater encourages microorganisms (or “bugs”) to remove dissolved and suspended organics and nutrients from the incoming wastewater.

Phosphorus Removal: A coagulant, ferric chloride, is added to the treatment process to aid in phosphorus and suspended solids removal.

Treated Effluent Pumping: Effluent from is pumped from the lagoons and is discharged to the Niagara River.

SD-T-2 Review of Lagoon Flows and Lagoon Influent Sampling and Monitoring

Review of 2025 Lagoon Flows

Table SD-T-1 below outlines the volume of sewage treated at the Stevensville-Douglastown Lagoon during the reporting year.

Table SD-T-1: Table of Stevensville-Douglastown Lagoon 2025 Treated Sewage Flows

Flow Statistic	Value
Design Average Daily Flow (ML/d)	2.289
Total Volume Wastewater Treated (ML)	462.557
Average Daily Flow (ML/d)	1.267
% Increase/Decrease over prior year	-9%
% Annual Average Daily Flow Utilization	56%

Reviewing the treated flows in 2025, it was observed that, on average, the lagoons utilize 56% of its design Average Daily Flow. This indicates that the facility has the hydraulic capacity to meet the needs of the collection system with room for additional flows that may be added from development. Should the average daily flow become greater than 80% of the Design Flow, facility expansion should be considered.

Daily flows to the lagoon were reviewed. In 2025, there were 14 instances where the flow to the lagoon was greater than the design Average Daily Flow, amounting to approximately 4% of the year. These instances occurred during times of wet weather or heavy snow melt suggesting increased flows are occurring due to Inflow and Infiltration.

It was noted that average daily flows decreased 9% in 2025 from 2024. A review of the monthly average daily flow rate for the prior 10-year period was completed. This can be observed below in Figure SD-T-1 below. The 10-year trend indicates the average daily flow rate has been slightly decreasing since 2021. Spikes are seen during typical wet weather seasons further support increased flows are occurring due to Inflow and Infiltration.

Niagara Region – Stevensville-Douglastown Wastewater System 2025 Annual Performance and Summary Report - Treatment

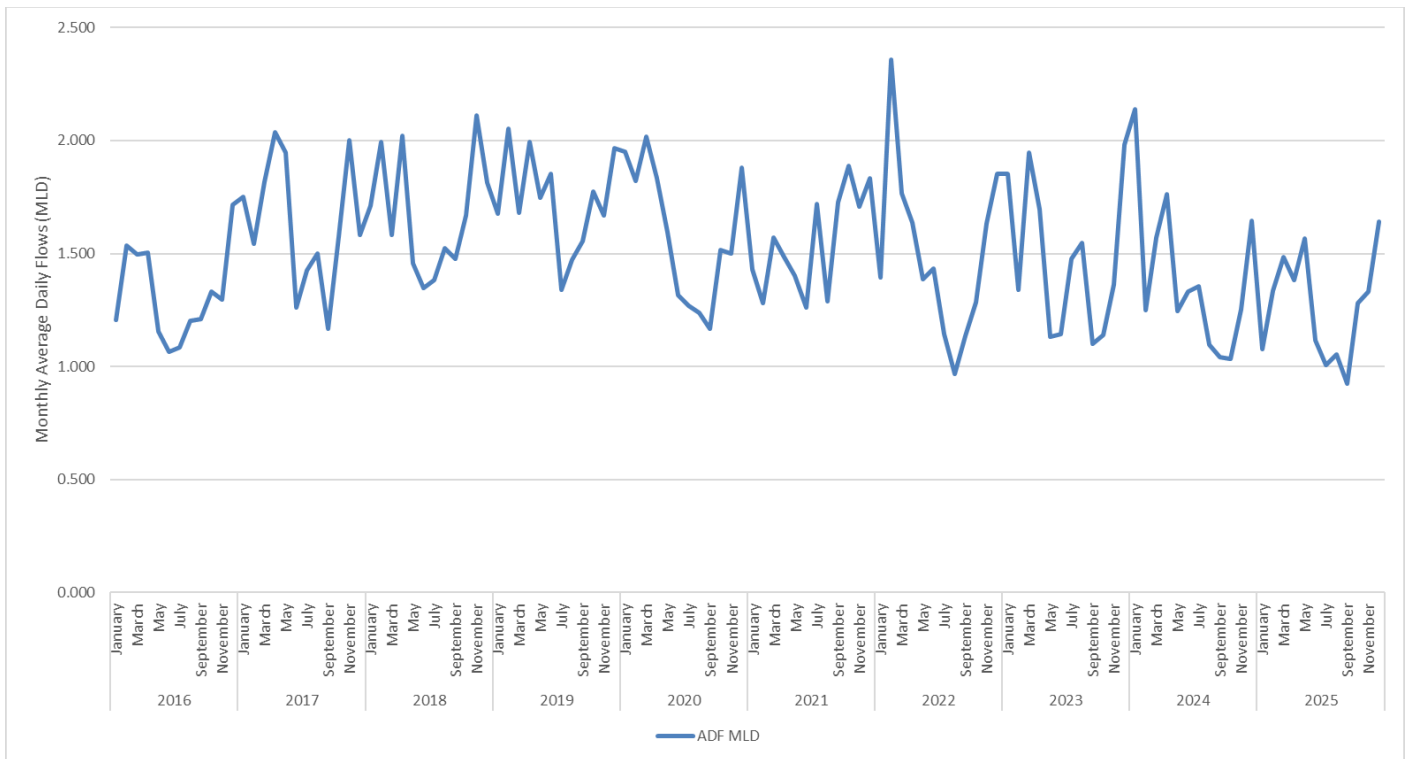


Figure SD-T-1: Graph displaying the Monthly Average Daily Flow Rate in MLD

Review of Influent Sampling and Monitoring Activities

In 2025, 105 samples of influent were collected and tested. An annual summary of influent sampling can be observed in Table SD-T-3.

Although the volume of sewage is an important consideration for the effective operation of a wastewater treatment facility, another important factor to monitor is plant loading. Lagoon loading displays if the strength of the sewage received at the lagoon is getting stronger or weaker. Stronger sewage may impact the amount of sewage the lagoon can treat effectively.

Lagoon loading is calculated by measuring the average strength of a pollutant per liter of influent sewage and multiplying it by the average volume of sewage received. This is generally displayed as kilograms of pollutant per day or kg/d. Below in Figure SD-T-2, is a graph depicting four (4) commonly monitored pollutant loadings to the lagoon for the period of 2023-2025.

Niagara Region – Stevensville-Douglastown Wastewater System 2025 Annual Performance and Summary Report - Treatment

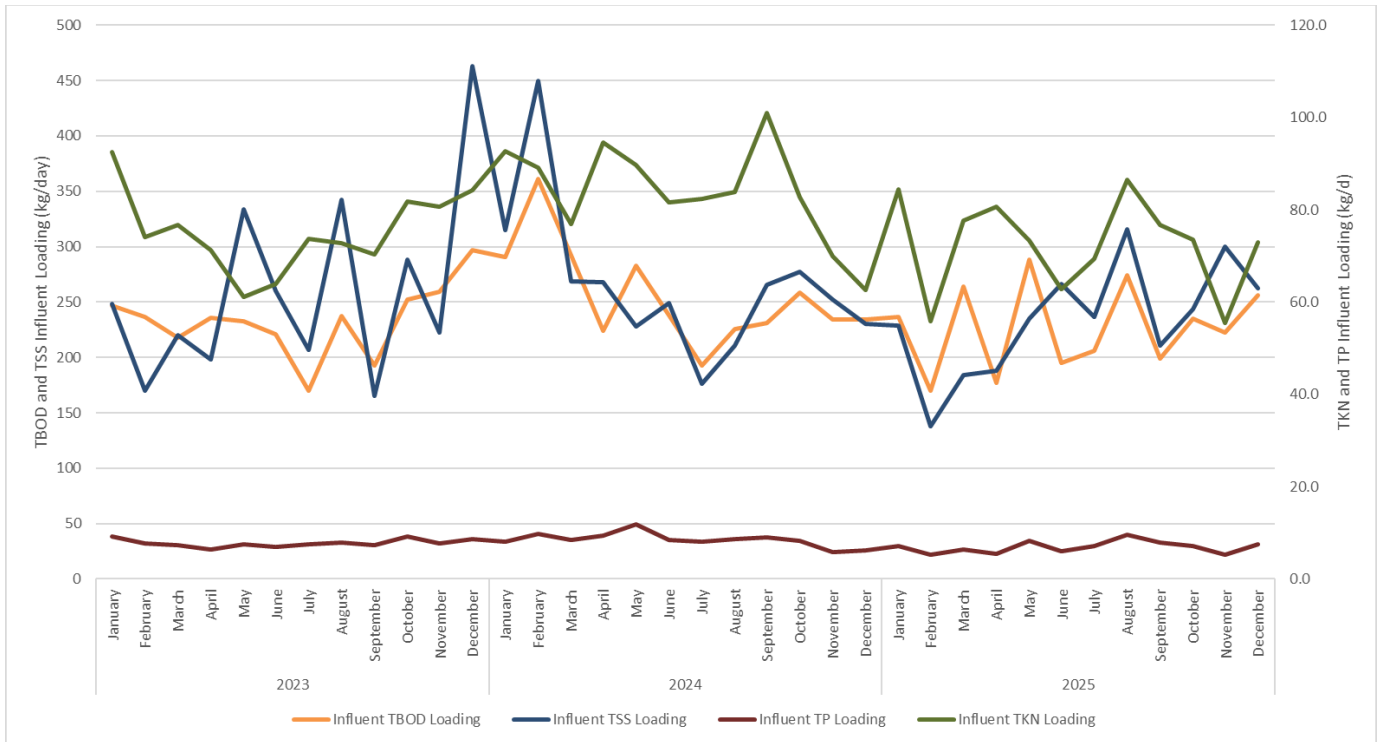


Figure SD-T-2: Figure of monthly lagoon loadings to the Stevensville-Douglastown Lagoon for Biochemical Oxygen Demand (TBOD), Total Suspended Solids (TSS), Total Kjeldahl Nitrogen (TKN) and Total Phosphorus (TP), in kg/d, for the period 2023 to 2025.

Reviewing the calculated loadings for TBOD, TSS, TKN and TP for the past 3 years the trending is consistent. An increase was observed in December 2023. Reviewing 2024 and 2025 trends shows the loading returning to previous levels. Trends will continue to be monitored to identify any persistent trends.

Review of Final Effluent Sampling and Monitoring Activities

In 2025, 84 samples of final effluent were collected and tested. Individual, monthly and annual average results are reviewed and compared to the objective and compliance limits stated in the facility ECA. Table SD-T-2 below summarizes the number of monthly and annual objective and compliance limit exceedances at the Stevensville-Douglastown Lagoon in the reporting year.

Niagara Region – Stevensville-Douglastown Wastewater System
2025 Annual Performance and Summary Report - Treatment

Table SD-T-2: Evaluation of Final Effluent sample results to ECA objectives and compliance limits

Parameter	ECA Concentration Objective	ECA Daily Concentration Limit	ECA Concentration Annual Average Limit	Number of Objective Concentration Exceedances	Number of Daily Limit Concentration Exceedances	Observed Annual Average (mg/L)	Annual Loading Limit (kg/d)	Observed Annual Loading (kg/d)
pH ¹	6.5-9.0	6.0-9.5	-	0	0	-	-	-
Carbonaceous Biochemical Oxygen Demand (CBOD)	15 mg/L	40.0 mg/L	25 mg/L	1	0	7.2	57.0	9.2
Total Suspended Solids (TSS)	15 mg/L	-	25 mg/L	3	-	12.4	57.0	15.7
Total Phosphorus (TP)	0.75 mg/L	-	1.0 mg/L	0	-	0.28	2.3	0.35
Total Ammonia (NH3) May 01 - October 31	-	10.0 mg/L	7.0 mg/L	-	11	8.73	16.0	10.12
Total Ammonia (NH3) Jan 01- Apr 30, Nov 01-Dec 31	-	15.0 mg/L	10.0 mg/L	-	2	10.49	23.0	12.81

¹pH must meet objectives/limits at all times (inclusive)
Section: Stevensville-Douglastown – Treatment (SD-T)

The annual concentration limit for Total Ammonia was exceeded in 2025 for the periods of January 01 to April 30, May 01 to October 31, and November 01 to December 31. Over the course of 2025, 13 daily limit exceedances for Total Ammonia occurred. The non-compliances for Total Ammonia can be attributed to a maintenance project completed at the end of 2024. More information can be found below in section SD-T-3 Operational Issues Encountered below.

Stevensville-Douglastown Lagoon had three monthly objective exceedances for Total Suspended Solids (TSS) and one monthly objective exceedance for CBOD₅.

A review of individual results against ECA objectives were also complete. Below summarizes the percentage of individual samples that were over the ECA objective:

- CBOD – 8%
- TSS – 24%
- TP – 2%

Final Effluent sample results did not exceed the ECA objective greater than 50% of the time.

An annual summary of monthly average final effluent sample results can be observed in Table SD-T-3 below.

Effluent Quality Assurance Measurements and Control Measures

To ensure Stevensville-Douglastown Lagoon continues to produce a high quality effluent the following measures have been implemented:

- Development and implementation of a Wastewater Quality Management System (WWQMS) program
 - This program promotes an environment of continuous improvement for all staff impacting the quality of wastewater
- Development of an ISO 14001:2015 Environmental Management System
- Compliance samples are analyzed by an ISO 17025:2017 accredited laboratory unless sample results are required to be collected in the field at the time of sampling
- Standard Operating Procedures (SOPs) are in place to support proper sampling and field measurements
- A compliance sampling schedule is created each year to ensure regulatory requirements are being met, as a minimum
- Equipment used in the monitoring and measurement of Final Effluent quality are calibrated annually

Deviations from Scheduled Monitoring Program

Compliance sampling activities at the Stevensville-Douglastown Lagoon follow a scheduled monitoring program to ensure all provincial and federal requirements are met. A schedule is prepared for the upcoming year and is submitted to the MECP as part of the annual reporting requirement.

In 2025, there were 19 deviations from the scheduled sampling days. These deviations occurred when there was no effluent flow from the lagoon.

The 2026 sampling schedule is available upon request.

Table SD-T-3: Annual Summary of Lagoon Flows, Influent and Effluent Sampling and Monitoring Results

Measured Parameter	January	February	March	April	May	June	July	August	September	October	November	December	Total / Average	Total Samples Collected
Influent - Monthly Average TSS (mg/L)	213	103	124	136	150	239	235	300	228	190	225	160	192	
Number of Influent TSS Samples	9	8	8	9	9	8	10	8	9	9	8	10		105
Influent - Monthly Average TBOD5 (mg/L)	220	127	178	128	184	175	204	260	215	183	167	156	183	
Number of Influent TBOD5 Samples	9	8	8	9	9	8	10	8	9	9	8	10		105
Influent - Monthly Average TP (mg/L)	6.6	3.9	4.3	4.0	5.3	5.4	7.1	9.1	8.5	5.5	3.9	4.6	5.7	
Number of Influent TP Samples	9	8	8	9	9	8	10	8	9	9	8	10		105
Influent - Monthly Average TKN (mg/L)	78.5	41.7	52.2	58.4	46.7	56.2	68.7	82.1	83.0	57.3	41.6	44.5	59.2	
Number of Influent TKN Samples	9	8	8	9	9	8	10	8	9	9	8	10		105
Total Lagoon Influent Flows (ML)	33.331	37.440	46.038	41.436	48.585	33.471	31.252	32.658	27.741	39.753	56.571	50.893	479.169	
Daily Average (MLD)	1.075	1.337	1.485	1.381	1.567	1.116	1.008	1.053	0.925	1.282	1.886	1.642	1.267	
Final Effluent - Monthly Average TSS (mg/L)	20.6	11.1	17.1	10.3	6.7	9.8	7.5	7.5	13.9	14.0	22.4	7.5	12.4	
Final Effluent - Average Daily TSS Loading (kg/d)	22.1	14.8	25.4	14.2	10.5	10.9	7.6	7.9	12.9	18.0	42.2	12.3	15.7	
Number of Final Effluent TSS Samples	7	8	8	9	3	8	4	8	8	3	8	10		84
Final Effluent - Monthly Average CBOD5 (mg/L)	19.7	8.8	9.9	4.6	4.0	4.0	4.3	4.2	6.0	7.1	9.1	5.1	7.2	
Final Effluent - Average Daily CBOD5 Loading (kg/d)	21.2	11.8	14.7	6.4	6.3	4.5	4.3	4.4	5.5	9.1	17.2	8.4	9.2	
Number of Final Effluent CBOD5 Samples	7	8	8	9	3	8	4	8	8	3	8	10		84
Final Effluent - Monthly Average TP (mg/L)	0.33	0.36	0.46	0.15	0.10	0.18	0.38	0.26	0.44	0.23	0.19	0.22	0.28	
Final Effluent - Average Daily TP Loading (kg/d)	0.35	0.48	0.68	0.21	0.16	0.20	0.38	0.27	0.41	0.29	0.36	0.36	0.35	
Number of Final Effluent TP Samples	7	8	8	9	3	8	4	8	8	3	8	10		84
Final Effluent - Monthly Average NH3 (mg/L): Jan 01 - Apr 30, Nov 01-Dec 31	11.44	12.35	11.94	12.03							6.41	8.77	10.49	
Final Effluent - Average Daily NH3 Loading (kg/d): Jan 01 - Apr 30, Nov 01-Dec 31	12.3	16.5	17.7	16.6							12.1	14.4	15.4	
Final Effluent - Monthly Average NH3 (mg/L): May 01 - Oct 31					12.30	13.95	8.28	6.23	6.49	5.10			8.73	
Final Effluent - Average Daily NH3 Loading (kg/d): May 01 - Oct 31					19.3	15.6	8.3	6.6	6.0	6.5			10.1	
Number of Final Effluent NH3 Samples	7	8	8	9	3	8	4	8	8	3	8	10		84
Final Effluent - Monthly Average TKN (mg/L)	15.83	16.55	19.64	14.14	13.77	15.58	10.08	8.41	8.84	8.17	9.89	11.03	12.66	
Number of Final Effluent TKN Samples	7	8	8	9	3	8	4	8	8	3	8	10		84
Final Effluent - Monthly Average NO3 (mg/L)	0.31	0.33	0.41	0.50	0.60	0.55	0.55	0.31	0.30	0.73	1.24	1.06	0.57	
Number of Final Effluent NO3 Samples	7	8	8	9	3	8	4	8	8	3	8	10		84
Final Effluent - Monthly Average Temperature (°C)	6.1	5.0	7.5	12.4	15.5	21.4	24.5	23.2	18.6	12.6	8.8	6.1	13.5	
Number of Final Effluent Temperature Samples	7	8	8	9	3	8	4	8	8	3	8	10		84

Niagara Region – Stevensville-Douglastown Wastewater System
 2025 Annual Performance and Summary Report - Treatment

Measured Parameter	January	February	March	April	May	June	July	August	September	October	November	December	Total / Average	Total Samples Collected
Final Effluent - Monthly Average pH	7.2	7.1	7.2	7.5	7.2	7.2	7.1	7.0	7.1	7.3	7.4	7.4	7.2	
Number of Final Effluent pH Samples	7	8	8	9	3	8	4	8	8	3	8	10		84

SD-T-3 Description of Operating Problems Encountered and Corrective Actions Taken

Upgrade work at the Stevensville-Douglastown Lagoon was completed in 2024. The Lagoons were returned to full service at the end of December 2024.

Following this return to full service, biomass development required re-establishment. Due to the young sludge age, the biomass had not yet fully matured to consistently support effective nitrification. This resulted in temporary impacts to effluent ammonia removal performance while biological treatment conditions stabilized, and biomass maturity increased.

This reduction in treatment efficiency resulted in Total Ammonia levels greater than the compliance limits for this facility. In an effort to reduce total ammonia concentrations in the lagoon effluent discharge, operational staff took the following corrective actions.

- Increased the retention time within the cells
- Activated a second blower to increase dissolved oxygen
- Closely monitored dissolved oxygen levels and process conditions to support nitrifying bacteria development.
- Monitored effluent quality at an increased frequency to track treatment performance

Operational issues related to the reduction in treatment efficiency also impacted total suspended solids removal in January and March and CBOD removal in January. Increased flows and algae production were contributing factors to the increase in suspended solids in November.

SD-T-4 Summary of Major Maintenance Activities and Capital Works

Summary of Maintenance Carried out on Major Equipment

Niagara Region works to keep wastewater infrastructure in a state of good repair. Maintenance activities completed include regular preventative maintenance (PM) activities and normal and emergency equipment repair or replacement. Where a substantial amount of upgrade is required, this work is carried out under the capital works program.

There were no normal or emergency repairs carried out on major equipment at the Stevensville-Douglastown Lagoon in 2025.

This does not include PM activities. PMs are completed and tracked in a computerized maintenance management system. PMs completed during the reporting year are available upon request.

Planned Capital Upgrades

There are no planned capital upgrades for the Stevensville-Douglastown Lagoon system for the near future.

Summary and Update of Notice of Modifications Completed

Through the facility ECA, the MECP has given System Owners the ability to complete low risk changes to a treatment facility without requiring approval from the MECP. These modifications are documented on a Notice of Modification form and are signed off by the Owner or delegate of the system. Any pre-authorized modifications must be reported on annually to the MECP.

During the reporting year 2025, no Notices of Modification were completed.

No Notice of Modification forms were completed in previous reporting years. No status update is required.

Proposed Works – Status Update

There were no Proposed Works to be reported on for the 2025 reporting period.

SD-T-5 Summary Calibration Activities

Flow Meter Calibration – Influent, and Effluent

Flow meters measuring flows discharging to the environment are calibrated at minimum, once per calendar year. Below in Table SD-T-4 provides a summary of flow meter calibration.

Table SD-T-4: Summary of Flow Meter Calibration

Meter Name	Date Calibrated	Comments
Effluent Meter - Stevensville-Douglastown Lagoon	2025-05-05	Passed
Effluent Meter - Stevensville-Douglastown Lagoon	2025-11-04	Passed
Influent Meter – Stevensville SPS	2025-05-06	Passed
Influent Meter – Stevensville SPS	2025-11-04	Passed
Influent Meter – Douglastown SPS	2025-05-05	Passed
Influent Meter – Douglastown SPS	2025-11-04	Passed

Calibration certificates are available upon request.

Effluent Monitoring Equipment Calibration/Verification

It is a requirement to calibrate, or, where unable to calibrate, verify equipment that is used to measure effluent quality.

Some effluent monitoring equipment calibration or verification is completed daily or as used by operations staff such as pH meter calibration or verification of the Total Residual Chlorine colorimeter.

Once annually, a third-party contractor performs calibration or verification on all effluent monitoring equipment. A summary of third-party calibration/verification activities are available in Table SD-T-5 below.

Table SD-T-5: Summary of Calibration/Verification of Effluent Monitoring Equipment

Equipment Description	Date Calibrated	Comments
pH Meter - Thermostar	2025-09-18	Passed

Calibration certificates are available upon request.

SD-T-6 Solids Handling

Processed Organics Received

No processed organics were received at the Stevensville-Douglastown Lagoon during the reporting period. Stevensville-Douglastown does not typically receive processed organics.

Volumes of Sludge Generated and Removed From Site

In the facultative lagoon process, solids removed during the treatment process accumulate at the bottom of the lagoons as a sludge layer and are removed when required.

No sludge was removed from site in 2025.

Sludge Quality Monitoring

No sludge quality monitoring was completed in 2025.

SD-T-7 Complaints

No complaints were received regarding the operations of the Stevensville-Douglastown Lagoon in 2025.

When a complaint is received, operations staff attend the site to verify the complaint. Corrective actions are taken if required based on the site verification. All complaints and corrective actions are logged in a complaint tracking system.

SD-T-8 Bypasses, Overflows, Other Situations Outside Normal Operating, Spills and Abnormal Discharge Events

Bypasses and Overflows

The Stevensville-Douglastown Lagoon is not equipped with bypass or overflow structures. The lagoon system does not bypass or overflow to the environment.

Situations Outside of Normal Operating Conditions

The MECP defines “Normal Operating Conditions” as when all unit process(es), excluding Preliminary Treatment System, in a treatment train is operating within its design capacity.

Spills

Niagara Region strives to maintain and operate wastewater infrastructure so spills to the environment do not occur. However, circumstances may arise and a spill occurs due to equipment malfunction, failure or other reasons. Occasionally, a planned spill may required in order to safely complete required maintenance to critical equipment. In the event that this is necessary, approval from the MECP is obtained in advance.

All spills are reported to the MECP Spills Action Centre upon discovery. Spills are investigated and written reports are submitted to the MECP and Environment and Climate Change Canada as required by legislation. Below in Table SD-T-6 summarizes spills that occurred at the Stevensville-Douglastown Lagoons in 2025.

Table SD-T-6: Summary of spills occurring at the Stevensville-Douglastown Lagoons during the reporting year

Spill Date	MECP Incident Number	Short Description of Spill	Link to Public Spill Report
No spills occurred during 2025.			

Abnormal Discharges

An abnormal discharge is a discharge to the environment that is abnormal in quality or quantity. There were no abnormal discharges from the Stevensville-Douglastown Lagoons during this reporting year.

SD-T-9 Summary of Efforts to Achieve Conformance with F-5-1 and/or F-5-5

Summary of Efforts – Procedure F-5-1 – Secondary Treatment Equivalent

Procedure F-5-1 states wastewater treatment facilities are to provide treatment of wastewater to a minimum of secondary treatment equivalence. This means the lagoon should be designed to meet objectives of 15 mg/L for CBOD and TSS and 1 mg/L for TP.

As demonstrated above in section SD-T-1 and Table SD-T-3, Stevensville-Douglastown generally achieved effluent quality that met or exceeded design objectives for CBOD, TSS and TP. The observed annual averages for these parameters was 7 mg/L for CBOD, 12 mg/L for TSS and less than 0.3 mg/L for TP.

Summary of Efforts – Procedure F-5-1 – Sewage Bypass/Overflow from Nominally Separated System

Procedure F-5-1 states that bypasses and overflows from nominally separated systems are not allowed except in emergency situations. Emergency situations include protection from basement flooding, preventing damage to lagoon equipment or pumping stations or to prevent treatment process washout.

There were no bypasses or overflows from the Stevensville-Douglastown Lagoon in 2025. The lagoon system provides a buffer against wet weather and mitigates the need for a lagoon bypass or overflow.

Industrial Waste

Industrial waste can contain material that can have negative impacts on collection system infrastructure as well as the wastewater treatment process itself. Upsets to the treatment process can cause a plant to become non-compliant with ECA objectives and limits. To protect our infrastructure, the Niagara Region has a Sewer Use By-law in place. Environmental Enforcement Officers conduct industry inspections, sampling and monitoring of industrial discharges on a routine basis to ensure that they meet the Sewer Use By-law limits.

In 2024, an update to the Sewer Use By-law was approved by Council. Sewer Use By-law 2024-51 is still in place ensuring better protection of Niagara Region wastewater infrastructure.

Summary of Efforts – Procedure F-5-5

The MECP Procedure F-5-5 applies to combined sewage systems. The Stevensville-Douglastown wastewater collection system is considered nominally separated. This procedure does not apply.

SD-C-1 Overview of the Stevensville-Douglastown Lagoon Collection System

The Stevensville-Douglastown Lagoon collection system is a class III system that collects wastewater from domestic, commercial and some industrial sources from the municipality of Fort Erie. The collection system consists of the following:

- Local sanitary sewers
- 1.2 kilometres of regional gravity mains
- 8.0 kilometres of regional force mains
- Two (2) pumping stations
 - Douglastown Sewage Pumping Station
 - Stevensville Sewage Pumping Station
- There is one (1) Sanitary Sewage Outfalls (SSO) located at one sewage pumping station within the collection system.



Figure SD-C- 1: Map of Stevensville-Douglastown Lagoon Collection System

The collection system is operated under a two-tier system, where the Town of Fort Erie owns and operates local gravity sanitary sewers and Niagara Region owns and operates sewage pumping stations, forcemains and larger gravity sanitary sewers or trunk sewers. It is classified as a nominally separated system meaning that storm water is collected separately from sanitary sewage but the system may still be impacted by inflow and infiltration from sources such as roof leaders, foundation drains, leaky pipes and joints and maintenance holes.

The collection system operates under the following Consolidated Linear Infrastructure ECA:

- Stevensville-Douglastown Wastewater Collection System, 007-W602, issue number 1

Annual reporting has been prepared to meet the requirements of this approval.

SD-C-2 Summary and Interpretation of Collection System Monitoring Data

Monitoring of Pump Station Operations

Pump stations operate through automatic control and are monitored continuously using Supervisory Control and Data Acquisition (SCADA). Stations alarms are programmed to alert the operations staff at the Anger Avenue (Fort Erie) WWTP 24 hours a day of potential issues including but not limited to high wet well levels, pump faults, communication failures and standby generator status. Operators will respond to station alarms as required to ensure proper station operation.

Station operation is trended in SCADA. SCADA trends are reviewed daily by operations staff to evaluate station performance. Operators will look at pump cycle times, station discharge flow and pump duty rotation to identify potential issues. Where potential issues are identified, work orders are generated for follow up by maintenance staff.

In addition to SCADA monitoring, monthly station inspections are completed by operations staff. This includes inspection of the station and testing of standby generator equipment. In addition, starting in 2025, operations staff conducted two (2) visual inspections of the sanitary sewer overflow location in the Stevensville-Douglastown Lagoon collection system.

Sanitary Sewer Closed-Circuit Television Inspection Program

Niagara Region owns and maintains 151 kilometers of trunk sanitary gravity sewers, 175 kilometers of sanitary forcemains, and 2,093 sanitary access chambers across 11

municipalities. Approximately 85% of its conventional trunk sanitary gravity system is inspected using closed-circuit television (CCTV) once every three years. The remaining 15% is large diameter trunk sewers, which are inspected once every 10 to 15 years due to the necessity for specialized equipment to access and inspect sewers that have continuous high flow levels.

Table SD-C- 1- CCTV Program Summary

Measurement in Kilometers (km)	2022	2023	2024	2025
Inspection Length (km)	59.3	33.0	31.3	58.7

Observations from the inspections are recorded for structural and operational deficiencies of the pipes. Operational deficiencies (blockage from grease, roots, debris) are addressed through the cleaning/flushing program. Structural deficiencies (broken, fractured, surface damage, holes) as well as Inflow and Infiltration are forwarded for consideration in the asset management plan and capital upgrade program.

Flow Monitoring

Niagara Region monitors sewer flows at 158 locations. Flow monitoring information is used for municipal Pollution Prevention and Control Plans (PPCPs), Master Servicing Plans (MSPs) including the 2021 Water and Wastewater MSP, Inflow and Infiltration studies, billing, development planning, and capital project design.

SD-C-3 Summary of Operating Issues Encountered and Corrective Actions Taken

Pump Stations and Forcemains

No pump station and forcemain operational issues were encountered in 2025.

Gravity Trunk Sewers

No operational issues were experienced at the gravity trunk sewers in 2025.

SD-C-4 Summary of Major Maintenance, Capital Projects and Pre-Authorized Alterations

Summary of Maintenance Carried out on Major Equipment

Niagara Region works to keep wastewater infrastructure in a state of good repair. Maintenance activities completed include regular preventative maintenance (PM) activities and normal and emergency equipment repair or replacement. Where a

substantial amount of upgrade is required, this work is carried out under the capital works program.

Below is a summary of normal and emergency repairs carried out on major equipment in the Stevensville-Douglastown Collection System:

- Stevensville SPS – Discharge header repairs
- Stevensville SPS – Sewage lift pump #2 rebuild

This list does not include PM activities. PMs are completed and tracked in a computerized maintenance management system. PM completed during the reporting year are available upon request.

Planned Capital Upgrades

There are no planned capital upgrades forecasted for the Stevensville-Douglastown Collection System at this time.

Summary of Pre-Authorized Alterations Undertaken

Through collection system ECAs, MECP has given System Owners the ability to complete low risk changes to a sewage pumping station, forcemain or gravity main without requiring further approval from the MECP. These modifications are documented on an applicable MECP form and signed off by the Owner or delegate of the system. Any pre-authorized modifications must be reported on annually to the MECP.

During the reporting year 2025, no pre-authorized modifications were completed.

No pre-authorized works were completed and therefore, there were no alterations that would pose a significant threat to drinking water.

SD-C-5 Summary of Calibration Activities

No calibration activities were completed in the collection system in 2025.

SD-C-6 Summary of Complaints

No complaints were received in 2025 regarding the operation of the Stevensville-Douglastown collection system.

SD-C-7 Summary of Collection System Overflows and Spills

Collection System Overflows

Although the Stevensville-Douglastown lagoon collection system is nominally separated, collection system overflows may occur during wet weather events due to inflow and infiltration of storm water into the sewage collection system. Overflows are necessary to prevent basement flooding and to protect downstream infrastructure and wastewater treatment processes.

In 2025, there were no collection system overflows from the Stevensville-Douglastown Lagoon system.

More [information on sewage overflows and inflow and infiltration](http://www.niagararegion.ca/living/sewage/cso), is available on the Region's website (www.niagararegion.ca/living/sewage/cso).

Collection System Spills

Niagara Region strives to maintain and operate wastewater infrastructure so spills to the environment do not occur. However, circumstances arise where a spill occurs due to equipment malfunction, failure or other reasons. Occasionally, a planned spill may be required to safely complete required maintenance to critical equipment. If this is necessary, approval from the MECP is obtained in advance.

All spills are reported to the MECP Spills Action Centre upon discovery. Spills are investigated and written reports are submitted to the MECP and Environment and Climate Change Canada as required by legislation. No spills occurred in the Stevensville-Douglastown collection system in 2025.

SD-C-8 Summary of Efforts to Reduce Lagoon Bypasses/Overflows and Collection System Overflows

Projects Undertaken to Reduce Bypasses or Overflows

The Stevensville-Douglastown Lagoon experiences high flow conditions that require overflows to occur due to inflow and infiltration in the collection system to prevent emergency situations. Being a two-tier system, Niagara Region works closely with the Town of Fort Erie to reduce overflows at the wastewater treatment plant.

There were no bypasses or overflows from the lagoon or Niagara Region collection system infrastructure in 2025.

Niagara Region participates in a cost sharing strategy with lower tier municipalities to fund overflow reduction projects. In 2025, Niagara Region had an approved budget totaling \$4.0M for the overflow reduction cost sharing program. Three (3) projects were approved for cost sharing in the Town of Fort Erie with Niagara Region contributing \$545,000 to support overflow reduction.

Public Reporting of Bypasses and Overflows

Niagara Region reports all [bypass and overflow events](#) publicly on the Niagara Region website

(<https://www.niagararegion.ca/living/sewage/CSO/Reporting/CSOLocations.aspx>)

Niagara Region updates the data on recent overflows four times a year and displays any overflows that may have occurred in the past 12 months.

A [listing of overflow data back to 2008](#) is available through the Niagara Open Data website (<https://niagaraopendata.ca/dataset/combined-sewage-overflow>)

A new public tool is now available that shows bypass and overflow status in near real time. It includes [a map of overflow locations](#) and their current status. The status shows if an overflow is happening now or if one occurred in the past 48 hours. This tool can help people make informed decisions about recreational water use.

(https://experience.arcgis.com/experience/76c72e893f93447c87e6ff717f78556d#data_s=id%3AdataSource_1-1922f276303-layer-1-0%3A37)

Niagara Region has posted signs at publicly accessible sites close to overflow locations that warn about potential hazards and precautions on water use following wet weather. These precautions are not in place at all times but are recommended after wet weather when overflows may affect water quality and safety.

Niagara Region – Stevensville-Douglastown Wastewater System
2025 Annual Performance and Summary Report - Treatment



Figure SD-C- 2 - Image of Sanitary Sewer Overflow Public Signage